

Web panel Model WEBP4100 USER MANUAL



Via Fermi 57/59, 10091 Alpignano (TO), Italy



[+39 011 9664616](tel:+390119664616) - srlmect@mect.it

C.F. e P.I. 04056380019

mect.it

ME7116_00
04/26

INDEX

1	Introduction.....	2
1.1	Staff qualification.....	2
1.2	Symbols.....	2
1.3	Safety	3
1.4	Characteristics.....	4
2	Mechanics	5
2.1	Drilling template	5
2.2	Depth.....	5
3	WEBP4100 Wiring.....	6
3.1	Power supply.....	6
3.2	Digital inputs.....	7
3.3	Digital outputs.....	7
3.4	RS485 Serials.....	8
3.5	Terminal block tip size M2	8
3.6	Isolations	8
3.7	Fuses.....	8
3.8	Peripherals.....	9
3.8.1	USB	9
3.8.2	Ethernet	9

1 Introduction

To ensure quick installation and commissioning of the devices described, we recommend that you carefully follow the information provided in this manual.

1.1 Staff qualification

The products described in this manual are to be used exclusively by personnel with experience in programming, or technicians specialized in the use of electrical devices. MECT Srl declines all responsibility for malfunctions and damages caused by improper use of MECT devices, due to failure to comply with the information contained in this manual. MECT Srl has a technical assistance laboratory.

1.2 Symbols

**Danger**

Please follow this information to protect people from harm.

**Warning**

Please follow this information to protect your device.

**Attention**

Conditions that must be observed for a more effective installation.

**ESD (Electrostatic Discharge)**

Warning: Possibility of damage to components due to electrostatic discharges.

**Note**

Steps to follow for a correct installation.

**Additional Information**

1.3 Safety

**Attention**

Turn off devices before working on terminals

ESD (Electrostatic Discharge)



The modules are equipped with electronic components that can be damaged by electrostatic discharge. Whenever you handle the modules, make sure that the environment is well grounded.

The instrument does not have an ON-OFF switch and an internal fuse, but it switches on immediately after supplying the correct supply voltage (check the supply voltage value indicated on the instrument label under the heading “Power”). Provide a power supply line that is as direct as possible and separate from the line that supplies the power elements.

For safety reasons, it is necessary to provide a two-phase disconnect switch with fuse located near the appliance and easily accessible by the operator.

Avoid having power elements (contactors, motors, drives, etc.), excessive humidity, heat sources and corrosive gases in the same panel.

The instruments must be powered by safety transformers or SELV type power supplies.

1.4 Characteristics

Broadcom BCM2711 SoC with a 1.5 GHz 64-bit quad-core ARM Cortex-A72 microprocessor system.

Table 1

Hardware Features	
Processor	Broadcom BCM2711 SoC with a 1.5 GHz 64-bit quad-core ARM Cortex-A72
RAM	2GB (4GB or 8GB options)
eMMC	8GB (16GB or 32GB options)
Real Time Clock	Present with rechargeable buffer battery/supercapacitor
Screen 10"	TFT 1280 x 800 pixels 16M colors
Touch screen	Capacitive
Ethernet 0	1Gb/s in auto-recognition
Ethernet 1	10Mbit/s - 100Mbit/s in self-recognition
USB 1	Host 2.0
USB 2	Host 2.0
RS485 – SERIAL PORT 0 on screen printing	2-wire serial - /dev/ttyAMA3 (RTS su GPIO7)
RS485 – SERIAL PORT 3 on screen printing	2-wire serial - /dev/ttyAMA4 (RTS su GPIO11)
Micro SD	NA
Case	Metallic
Protection level	IP65
Software Features	
Operating system	Linux Raspberry Pi OS 13 (Trixie) 64 bit
Supply voltage	
12 ÷ 36VDC	
Power absorbed	12W digital outputs excluded


Electromagnetic compatibility

Reference standard: IEC61131-2:2017

Precautions: USB cable < 1m; Digital I/O < 3m; LAN and serial < 30m.

2 Mechanics

Metal case.

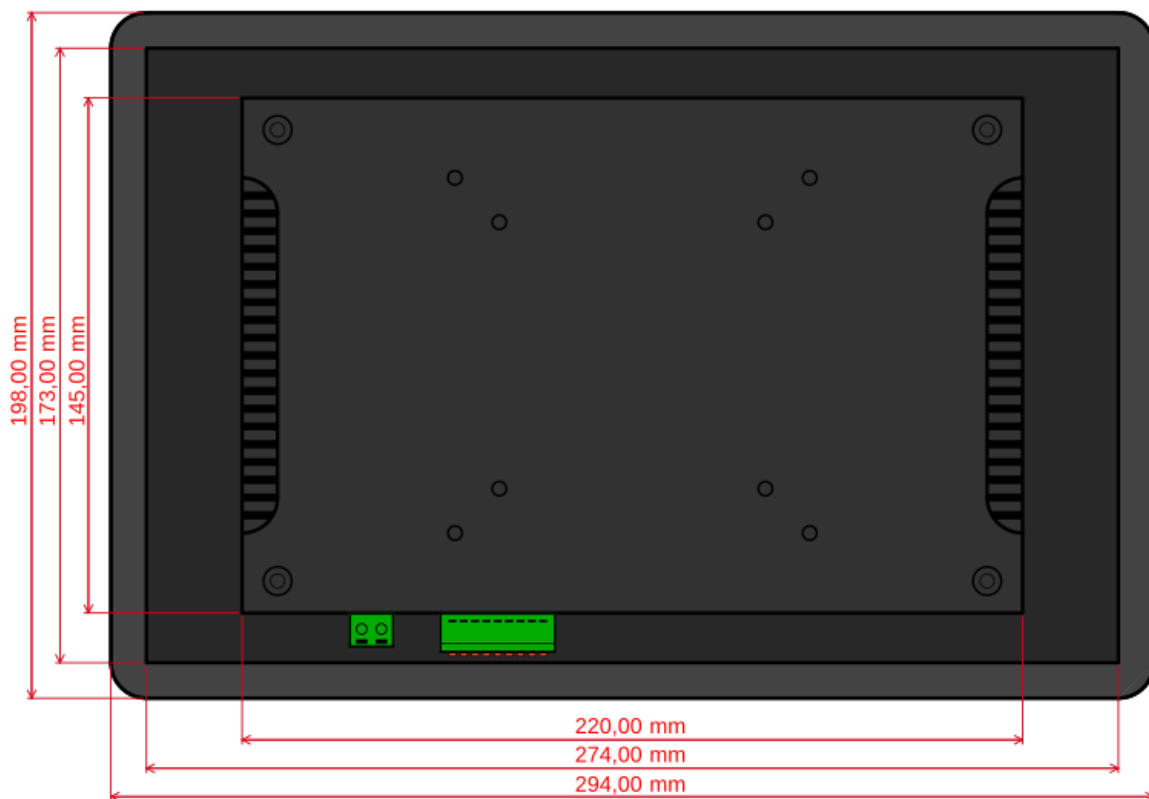

2.1 Drilling template



2.2 Depth



3 WEBP4100 Wiring

The following figure shows the layout of the connectors on the panel.

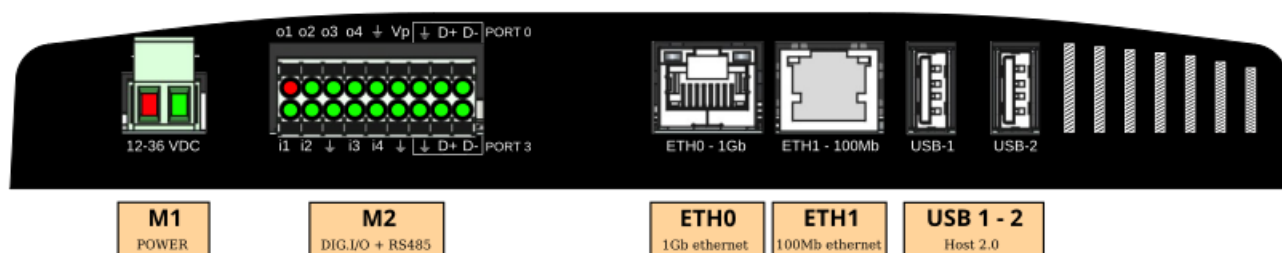


Table 2


ID	WEBP4100	
M1	Panel power supply	24Vdc 500mA
M2		1 line 4 output active-high 2 line 5 output active-high 3 line 6 output active-high 4 line 7 output active-high 5 GND 6 VPOT 7 GND 8 D0 + (UART3) /dev/ttyAMA3 9 D0 – (UART3) /dev/ttyAMA3 10 line 0 input active-high 11 line 1 input active-high 12 GND 13 line 2 input active-high 14 line 3 input active-high 15 GND 16 GND 17 D1 + (UART4) /dev/ttyAMA4 18 D1 – (UART4) /dev/ttyAMA4
ETH0	Ethernet 1Gb (IP default in DHCP)	Bit rate max: 1Gbit/sec
ETH1	Ethernet 100Mb (IP default:192.168.5.211)	Bit rate max: 100Mbit/sec
USB 1	USB A 1	Host 2.0
USB 2	USB A 2	Host 2.0

3.1 Power supply

If the panel is powered at the nominal voltage of 24Vdc, a power supply that can supply at least 2A is required.

3.2 Digital inputs


The WEBP4100 Web panel has 4 PNP digital inputs available. The connection is shown in the following figure.

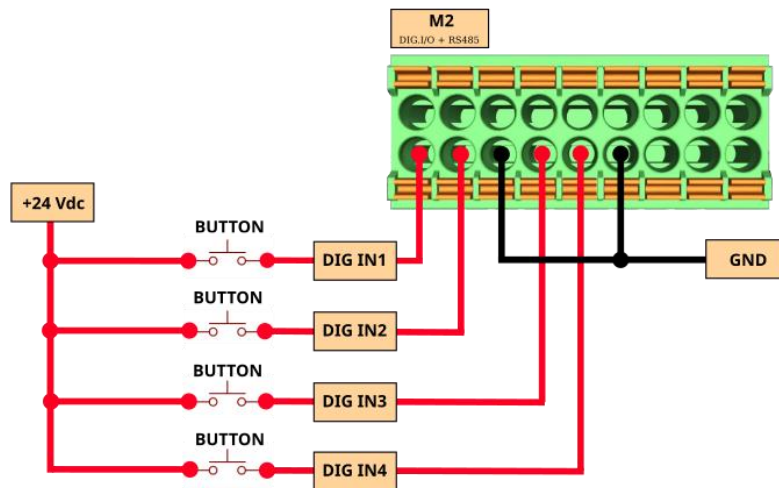

3.3 Digital outputs


The WEBP4100 Web panel has 4 PNP digital outputs available. The connection is shown in the following figure.

Note: The power supply for the digital outputs must be brought to terminal 6.

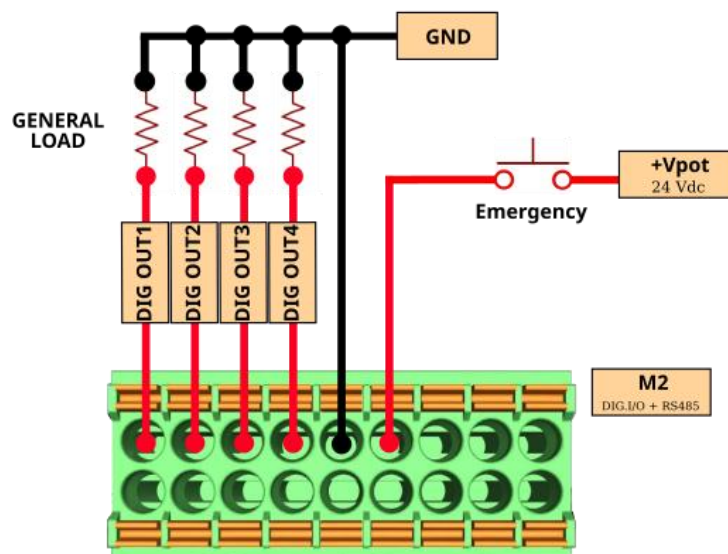

3.4 RS485 Serials

The WEBP4100 Web panel has 2 RS485 channels available. The connection is shown in the following figure.

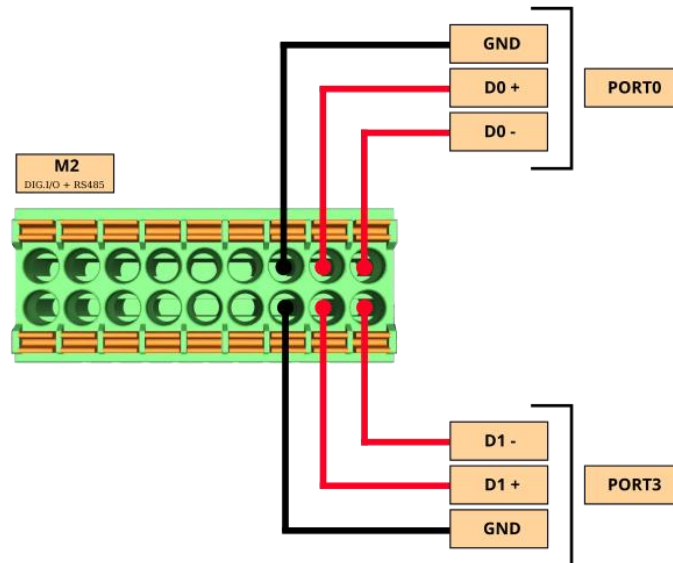

3.5 Terminal block tip size M2

For wiring on terminal block M2, which contains digital inputs and outputs as well as RS485, we recommend using the following socket terminals:

1. conductor diameter 0.34mm^2 and terminal length 10mm
2. conductor diameter 0.5mm^2 and terminal length 10mm
3. conductor diameter 1mm^2 and terminal length 10mm

3.6 Isolations

The device does not provide galvanic isolation zones between inputs, outputs and power supply.

3.7 Fuses

The system does not provide internal fuses, however, to protect the input stage of the WEBP4100 Web panel power supply, it is recommended to insert a 2A fuse.



Attention

Using an incorrect power supply voltage may cause irreversible damage to the devices.

3.8 *Peripherals*

3.8.1 USB

The WEBP4100 Web panel features two USB 2.0 host ports , which can be used for:

- Save process data
- Connect peripherals with USB interface such as printers, mice, keyboards, barcode scanners, etc.
- Software Updates

3.8.2 Ethernet

The WEBP4100 Web panel is equipped with two Ethernet ports, one 10/100Mbit/s in autonegotiation (default static IP address 192.168.5.211), the other 1Gbit/s (default IP address in DHCP), furthermore the connection cable between the WEBP4100 and a personal computer can be either direct or crossed.